

**TOWN OF LENOX
FIRE MARSHAL'S OFFICE**

DEPARTMENT OF PUBLIC SAFETY
CODE ENFORCEMENT OFFICE
FIRE MARSHALS OFFICE
Timothy S. Cowan
Code Enforcement Officer
Fire Marshal



205 Peterboro Street
Canastota, NY 13032
TEL: 315-697-5575
FAX: 315-697-5514
tolfire@cnymail.com
www.lenoxny.com

SOLID FUEL BURNING DEVICE PERMIT APPLICATION

- OWNER: _____
- ADDRESS: _____
- TAX MAP #: _____
- PHONE NUMBER: _____
- TYPE OF UNIT: (circle one) fireplace woodstove coal stove pellet stove propane stove other
- MANUFACTURE: _____
- MODEL# _____ SERIAL# _____
- BTU RATING: _____
- COMBUSTION CHAMBER SIZE: WIDTH _____ DEPTH _____ HEIGHT _____
- ROOM OF USE: _____ FLOOR OF USE: _____
- CHIMNEY TYPE: (circle one) block/flue brick/flue double wall triple wall
- THREE SCREWS OR RIVETS IN EVERY JOINT (circle one) yes no
- DOES THE FLUE SERVE ANY OTHER APPLIANCES? (circle one) yes no
- IS THERE AN AIRTIGHT CLEAN-OUT DOOR ON THE CHIMNEY? yes no
- TYPE & SIZE OF NON-COMBUSTIBLE HEARTH _____
- STOVE CLEARANCES: LEFT SIDE _____ RIGHT SIDE _____ FRONT _____
TOP _____ FLOOR _____
- HAS THERE EVER BEEN A CHIMNEY FIRE IN THE PAST? yes no unknown



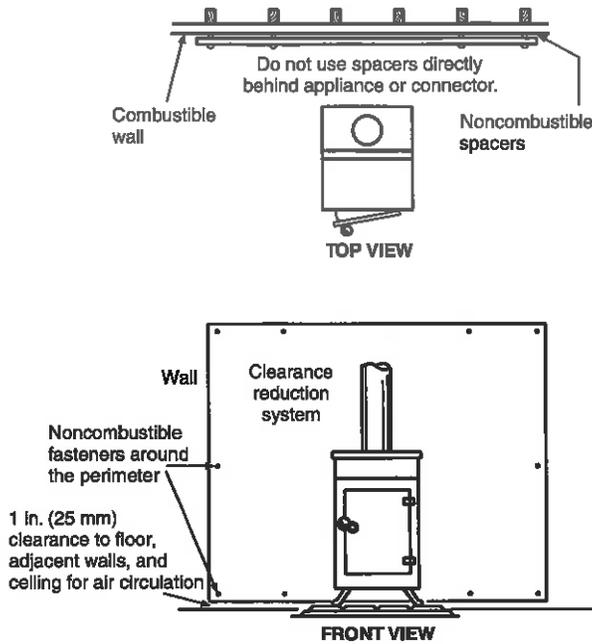


FIGURE 13.6.2.1(a) Clearance Reduction System — Fastener Location.

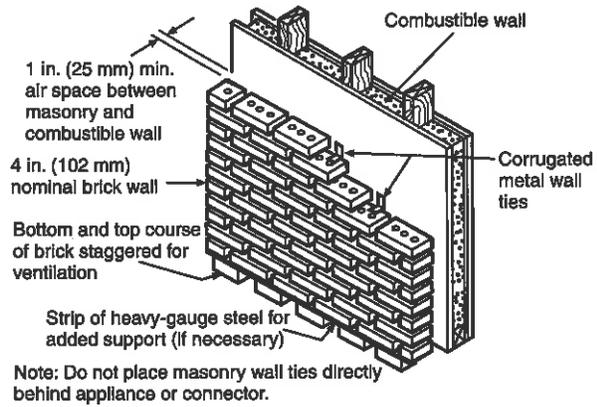


FIGURE 13.6.2.1(c) Masonry Clearance Reduction System.



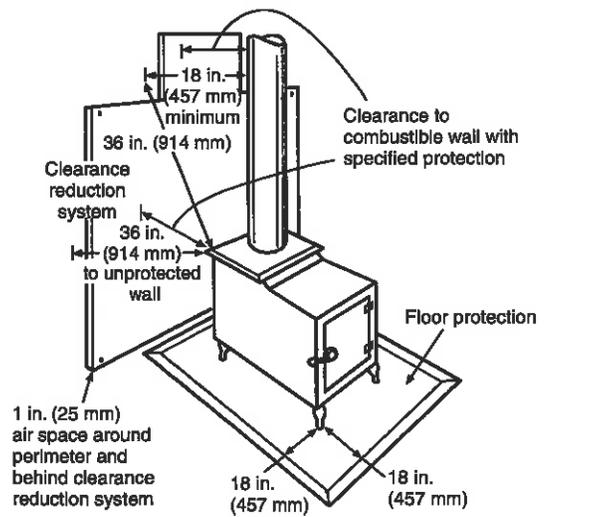


FIGURE 13.6.2.1(b) Distance to Combustible Wall/Floor.

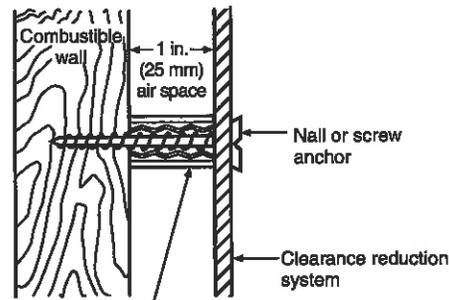

1 in. (25 mm) noncombustible spacer such as stacked washers, small-diameter pipe, tubing, or electrical conduit

Notes:

- (1) Masonry walls can be attached to combustible walls using wall ties.
- (2) Do not use spacers directly behind appliance or connector.

FIGURE 13.6.2.1(d) Fastener Detail.

**TOWN OF LENOX
FIRE MARSHAL'S OFFICE**

**DEPARTMENT OF PUBLIC SAFETY
CODE ENFORCEMENT OFFICE
FIRE MARSHALS OFFICE**

Timothy S. Cowan
Code Enforcement Officer
Fire Marshal



205 Peterboro Street
Canastota, NY 13032
TEL: 315-697-5575
FAX: 315-697-5514
tolfire@cnymail.com
www.lenoxny.com

To: Solid Fuel Burning Device Applicants

From: Town of Lenox Fire Marshal

Subject: Smoke and Carbon Monoxide Detectors

Pursuant to the 2020 Property Maintenance Code of New York State;

Section 704.6.1.1 Single- or multiple-station smoke alarms shall be installed and maintained in all of the following locations in Group R (residential) occupancies:

1. In sleeping areas.
2. In every room in the path of the *means of egress* from the sleeping area to the door leading from the *sleeping unit*.
3. In each story within the *sleeping unit*, including basements. For *sleeping units* with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper levels, a smoke alarm installed on the upper level shall suffice for the adjacent lower provided that the lower level is less than one full story below the upper level.

Pursuant to the 2020 Fire Code of New York State;

Section 915.1 New and existing residential buildings and commercial buildings shall be provided with carbon monoxide detection and notification.

Along with meeting the conditions of the solid fuel burning device permit application, the appropriate number of smoke and carbon monoxide alarm shall be installed and in working order at the time of inspection.

